
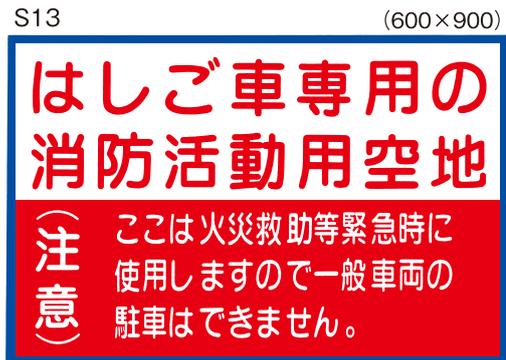


消防標識

FIRE HYDRANT
消火栓

消防水利


FIRE CISTERN
防火水そう

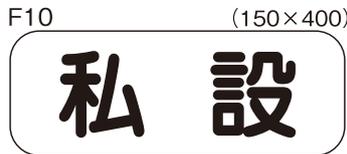



○○○は管理責任者を有する事業所・組合名及び消防署名等を記入。

標識参考設置図

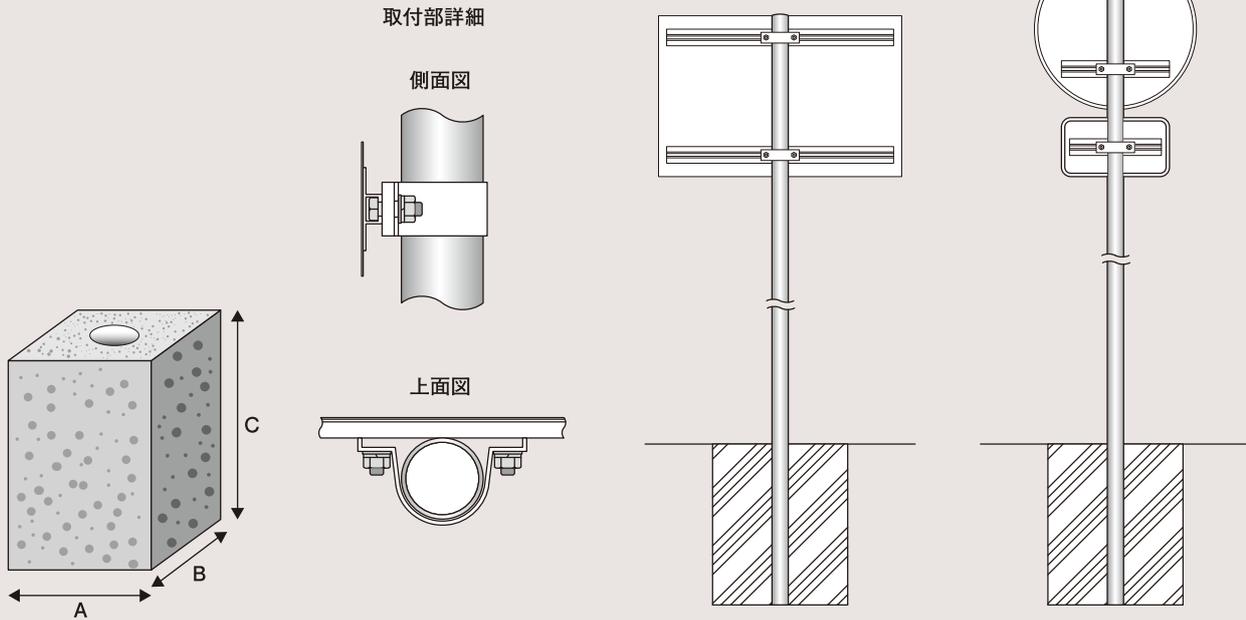

支柱標準在庫及び推奨基礎寸法

鋼管 (JIS G 3444 STK 400)

(設計風速40m/sec)

支柱仕様・寸法	取付標識寸法			
	φ600	φ600+補助板 (220×400)	500 × 600	600 × 900
白色粉体塗装	A × B × C	A × B × C	A × B × C	A × B × C
φ60.5×t3.2×2500	500 × 500 × 500	500 × 500 × 600	500 × 500 × 500	600 × 600 × 600
3000	500 × 500 × 600	500 × 500 × 700	500 × 500 × 600	600 × 600 × 700
3300	500 × 500 × 600	600 × 600 × 600	500 × 500 × 700	600 × 600 × 700
3500	500 × 500 × 700	600 × 600 × 600	500 × 500 × 700	600 × 600 × 700
4000	600 × 600 × 600	600 × 600 × 700	600 × 600 × 600	600 × 600 × 700
溶融亜鉛メッキ	A × B × C	A × B × C	A × B × C	A × B × C
φ60.5×t3.2×3300	500 × 500 × 600	600 × 600 × 600	500 × 500 × 700	600 × 600 × 700
4000	600 × 600 × 600	600 × 600 × 700	600 × 600 × 600	600 × 600 × 700

・表記以外の寸法の場合、別途計算が必要です。・ねかせは別途、承ります。



KS-20

(その1) ダクタイト
(鋳鉄製)

(その2) 鋳




KS-21


設置現場




施工例

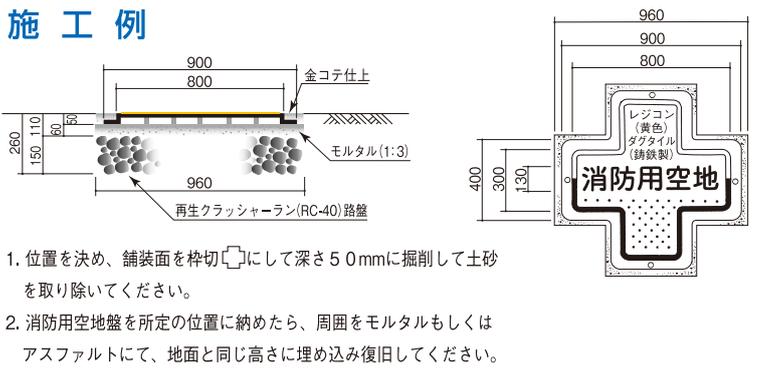

施工例

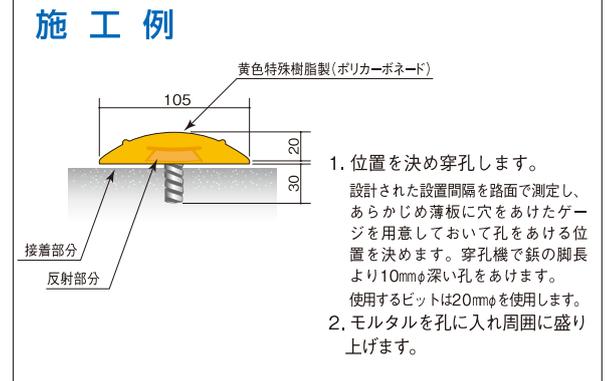

設置例

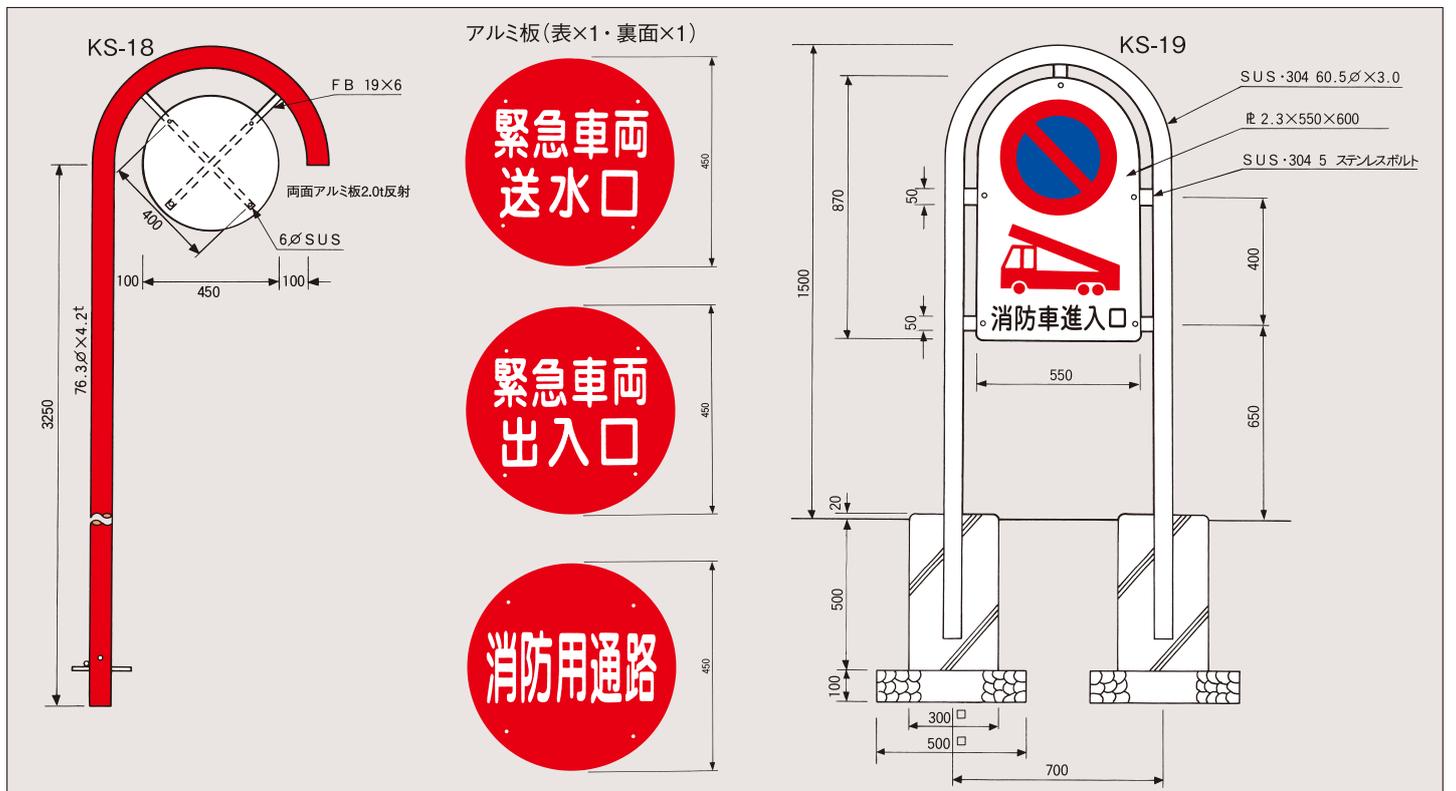

光和産業株式会社

〒547-0035 大阪市平野区西脇2丁目6番17号

TEL (06) 6701-0202 FAX (06) 6704-7747

http://www.kowa-sangyo.jp/